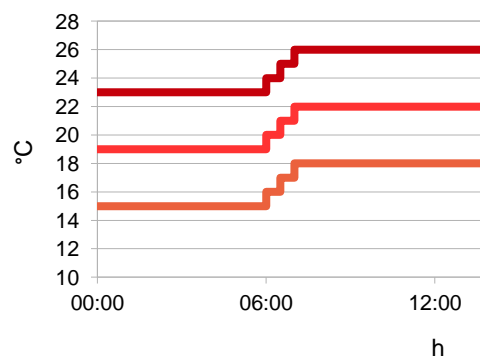
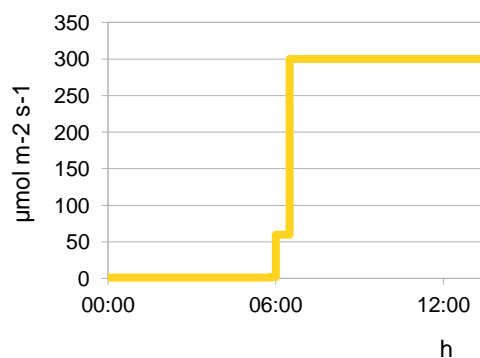


TEPLOTA


START hh:mm	STOP hh:mm	optimum °C	rozsah °C
00:00	06:00	19	4
06:00	06:30	20	4
06:30	07:00	21	4
07:00	20:00	22	4
20:00	20:30	21	4
20:30	21:00	20	4
21:00	00:00	19	4

**OSVIT**




START hh:mm	STOP hh:mm	hodnota $\mu\text{mol m}^{-2} \text{s}^{-1}$
00:00	05:50	1
05:50	06:00	2
06:00	06:30	60
06:30	19:30	300
19:30	20:00	60
20:00	20:30	2
20:30	00:00	1

**VLHKOST**

START hh:mm	STOP hh:mm	hodnota % rel.
00:00	06:00	65
06:00	10:00	50
10:00	14:00	30
14:00	15:00	40
15:00	19:00	50
19:00	00:00	65

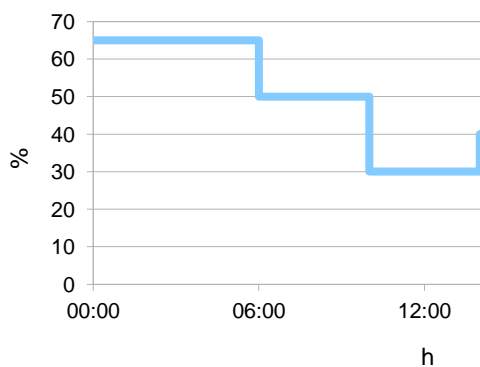

List1

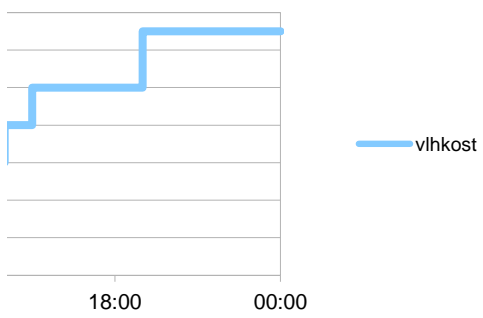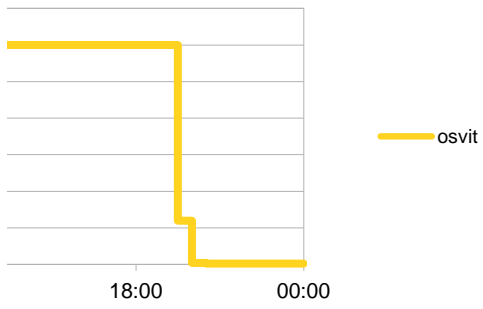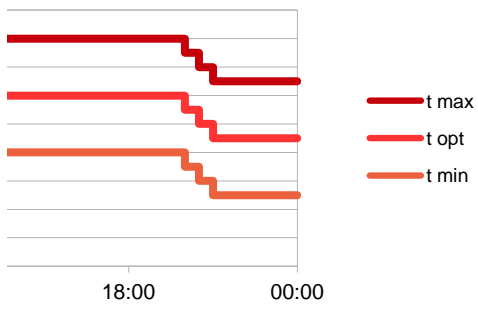

List2

TEPLOTA		0	0	0			
START	STOP	optimum	rozsah	time	t max	t opt	
00:00:00	06:00:00	19		4	00:00:00	23	19
06:00:00	06:30:00	20		4	06:00:00	23	19
06:30:00	07:00:00	21		4	06:00:00	24	20
07:00:00	20:00:00	22		4	06:30:00	24	20
20:00:00	20:30:00	21		4	06:30:00	25	21
20:30:00	21:00:00	20		4	07:00:00	25	21
21:00:00	24:00:00	19		4	07:00:00	26	22
0	0	0		0	20:00:00	26	22
0	0	0		0	20:00:00	25	21
OSVIT		0	0	0	20:30:00	25	21
START	STOP	hodnota					
hh:mm	hh:mm	$\mu\text{mol m}^{-2} \text{s}^{-1}$					
00:00:00	05:50:00	1		0	21:00:00	24	20
05:50:00	06:00:00	2		0	24:00:00	23	19
06:00:00	06:30:00	60		0			
06:30:00	19:30:00	300		0			
19:30:00	20:00:00	60		0			
20:00:00	20:30:00	2		0			
20:30:00	24:00:00	1		0			
0	0	0		0			
0	0	0		0			
VLHKOST		0	0	0			
START	STOP	hodnota					
hh:mm	hh:mm	% rel.		0 h	vlhkost		
00:00:00	06:00:00	65		0	00:00:00	65	
06:00:00	10:00:00	50		0	06:00:00	65	
10:00:00	14:00:00	30		0	06:00:00	50	
14:00:00	15:00:00	40		0	10:00:00	50	
15:00:00	19:00:00	50		0	10:00:00	30	
19:00:00	00:00:00	65			14:00:00	30	
					14:00:00	40	
					15:00:00	40	
					15:00:00	50	
					19:00:00	50	
					19:00:00	65	
					24:00:00	65	

List2

t min

15
15
16
16
17
17
18
18
17
17
16
16
15
15

h	osvit	
00:00:00		1
05:50:00		1
05:50:00		2
06:00:00		2
06:00:00		60
06:30:00		60
06:30:00		300
19:30:00		300
19:30:00		60
20:00:00		60
20:00:00		2
20:30:00		2
20:30:00		1
24:00:00		1