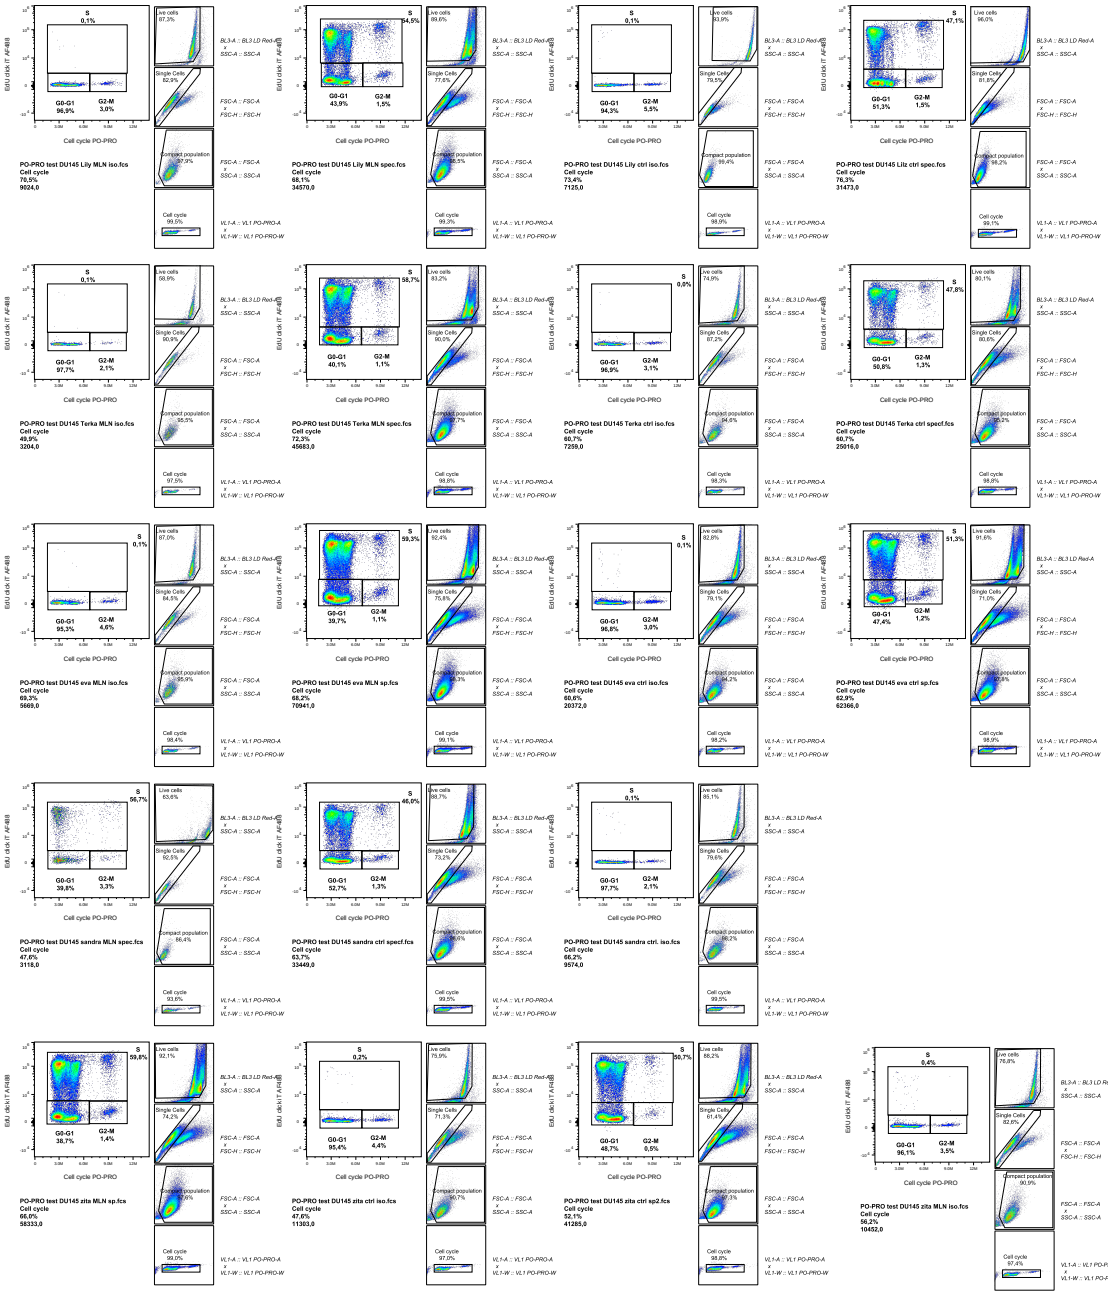
PO-PRO test DU145 Lily MLN iso.fcs
Cell cycle
70,5%
9024,0
PO-PRO test DU145 Lily MLN spec.fcs
Cell cycle
68,1%
34570,0
PO-PRO test DU145 Lily ctrl iso.fcs
Cell cycle
73,4%
7125,0
PO-PRO test DU145 Lilz ctrl spec.fcs
Cell cycle
76,3%
31473,0
PO-PRO test DU145 Terka MLN iso.fcs
Cell cycle
49,9%
3204,0
PO-PRO test DU145 Terka MLN spec.fcs
Cell cycle
72,2%
45683,0
PO-PRO test DU145 Terka ctrl iso.fcs
Cell cycle
68,7%
7259,0
PO-PRO test DU145 Terka ctrl specf.fcs
Cell cycle
60,7%
25916,0
PO-PRO test DU145 eva MLN iso.fcs
Cell cycle
69,3%
5669,0
PO-PRO test DU145 eva MLN sp.fcs
Cell cycle
68,2%
70941,0
PO-PRO test DU145 eva ctrl iso.fcs
Cell cycle
60,6%
20372,0
PO-PRO test DU145 eva ctrl sp.fcs
Cell cycle
62,9%
62366,0
PO-PRO test DU145 sandra MLN spec.fcs
Cell cycle
47,6%
3118,0
PO-PRO test DU145 sandra ctrl specf.fcs
Cell cycle
63,7%
33449,0
PO-PRO test DU145 sandra ctrl. iso.fcs
Cell cycle
68,2%
9574,0
PO-PRO test DU145 zita MLN sp.fcs
Cell cycle
66,0%
58333,0
PO-PRO test DU145 zita ctrl iso.fcs
Cell cycle
47,6%
11303,0
PO-PRO test DU145 zita ctrl sp2.fcs
Cell cycle
52,1%
41285,0
PO-PRO test DU145 zita MLN iso.fcs
Cell cycle
56,2%
10452,0